
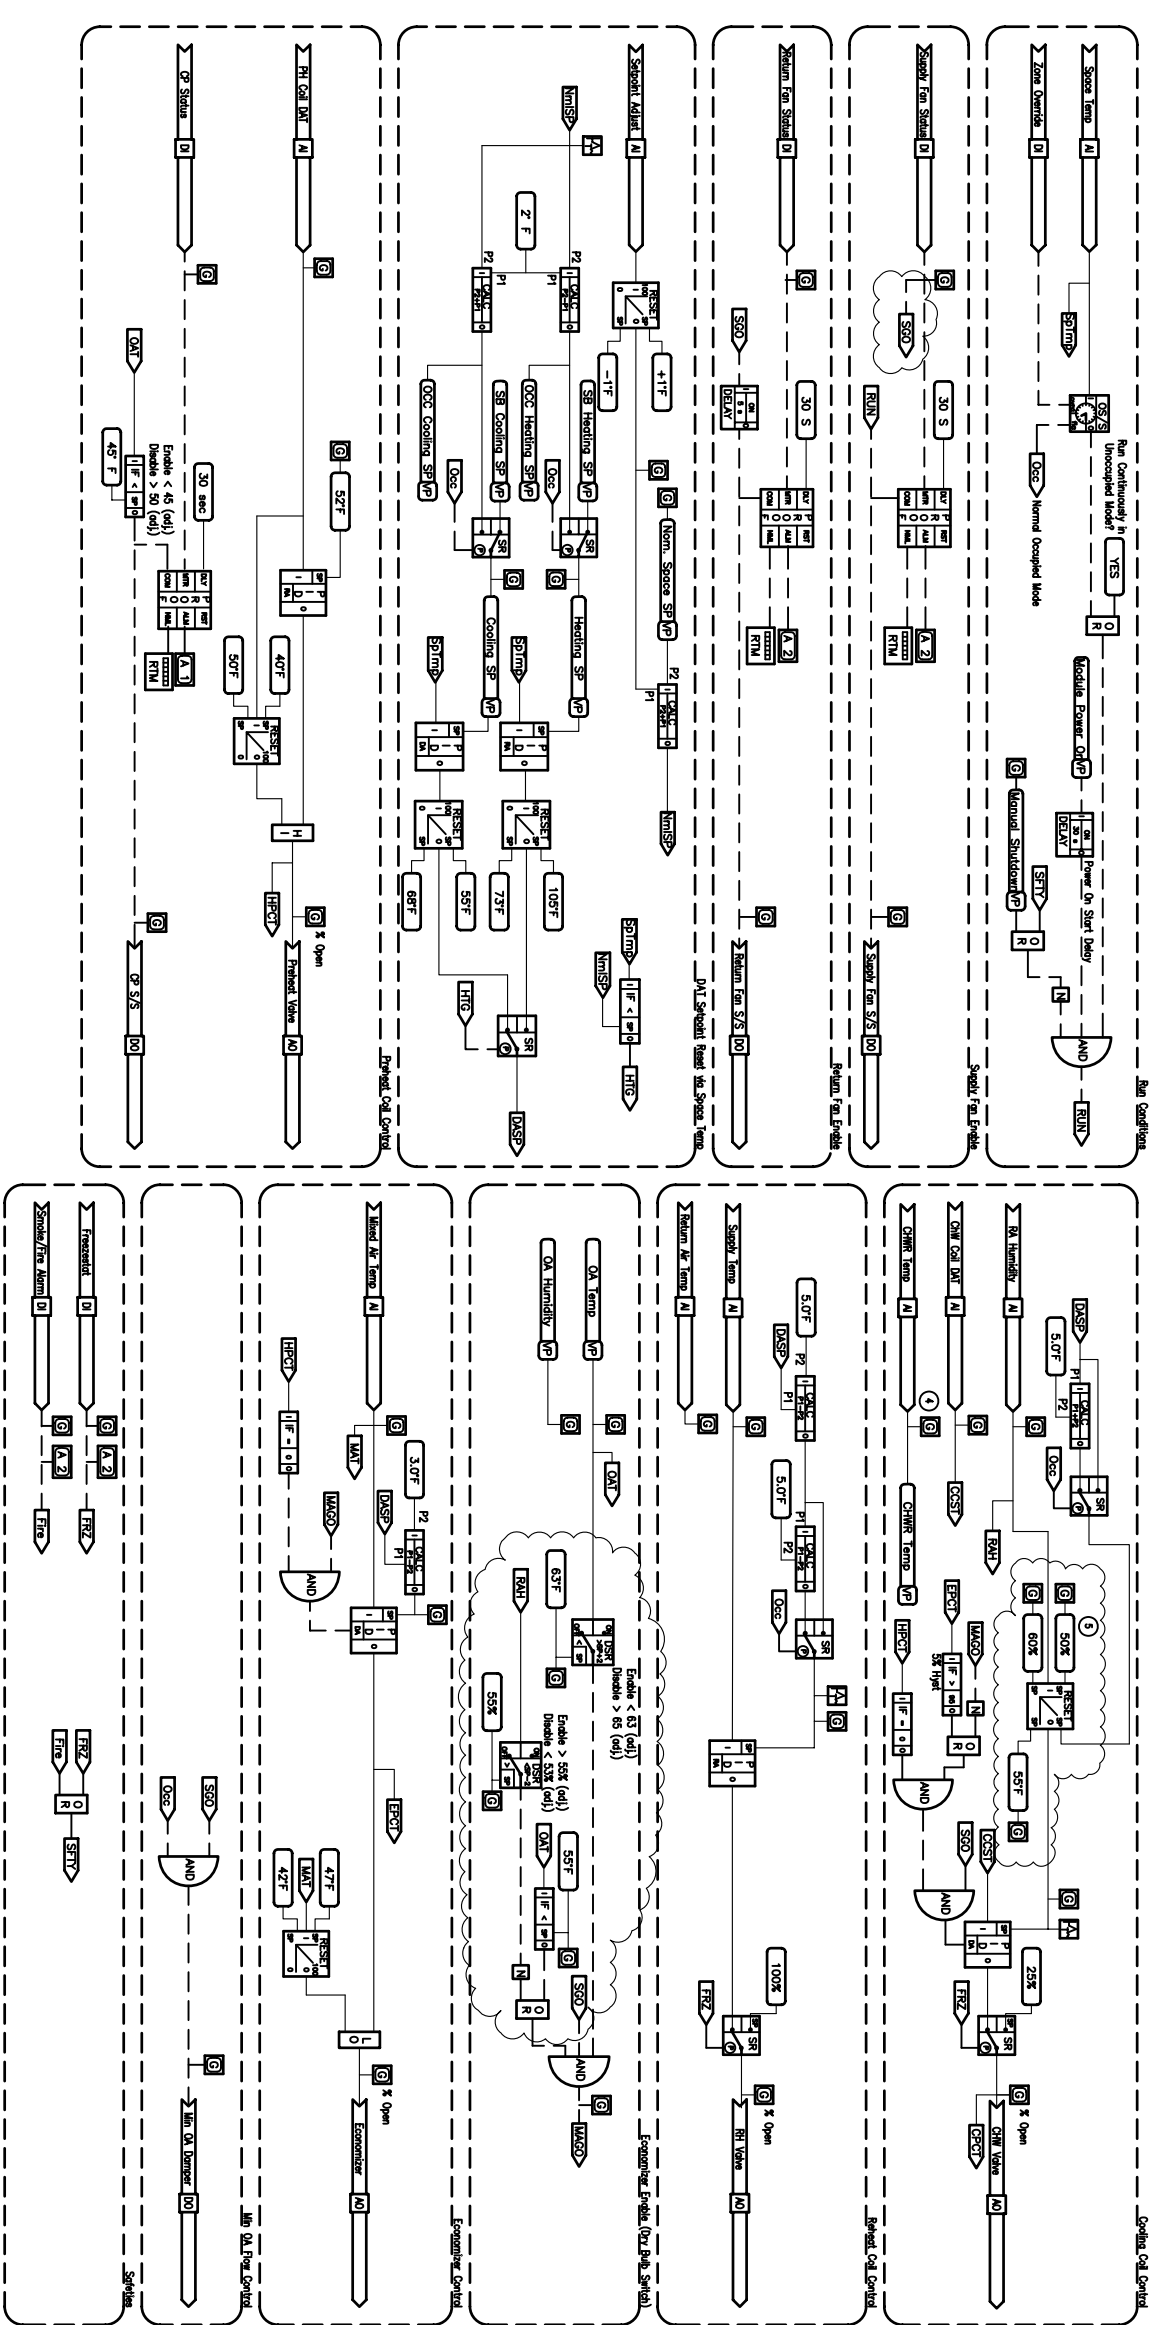


SINGLE DUCT CV AH WITH PREHEAT, CHW & REHEAT COIL, MIN OA DAMPER & RETURN FAN



POINTS LIST							REVISIONS			
ADDRESS	POINT DESCRIPTION	POINT TYPE					REMARKS	NO.	DESCRIPTION	DATE
		DI	AI	DO	AO	WP				
	Supply Fan S/S	*								
	Supply Fan Status	*			*					
	Return Fan S/S				*					
	Return Fan Status	*								
	Supply Temp				*					
	PH Coil DAT	*			*					
	Freeze/def	*								
	Mixed Air Temp	*	*		*					
	CHW Coil DAT	*	*		*					
	Space Temp	*	*		*					
	Setpoint Adjust	*	*		*					
	Zone Override	*								
	Return Air Temp	*	*		*					
	RA Humidity	*	*		*					
	Predict Voice	*			*					
	Circ Pump S/S		*		*		See Note 3			
	Circ Pump Status	*			*		See Note 3			
	CHW Valve	*	*		*					
	PH Valve	*	*		*					
	Economizer	*	*		*					
	Min OA Damper	*	*		*					
	CHWR Temp	*	*		*		See Note 2			
	Smoke/Fire Alarm	*			*					


[illegible]

The University of North Carolina  
Chapel Hill, North Carolina

## Standard Control Drawings



THE UNIVERSITY  
of NORTH CAROLINA  
at CHAPEL HILL



REV. 6

**SINGLE DUCT  
CV AH WITH  
PREHEAT, CHW  
& REHEAT  
COIL, MIN OA  
DAMPER &  
RETURN FAN**

00 OF 00  
.....  
SHEET NUMBER

C-1.03

.....  
DWG NUMBER